



Radon Inspection Report

Measurement Information

Client Name
City of Ketchum

Building Year
1975

Measurement Started
11/10/2023 13:09


Building Type
Condominium, 4-Plex

Measurement Ended
11/12/2023 13:12

Room Type
Bedroom

Inspection Duration
48 hour (Data No: 48)

Floor
1st floor




Measurement Location
225 Pinewood #C16
Ketchum, Idaho 83340

Test Result: **< EPA Guidelines**

Overall Average
1.6 pCi/L

EPA Average*
1.5 pCi/L

Note: The EPA average excludes the first 4 hours of data to follow EPA Protocol

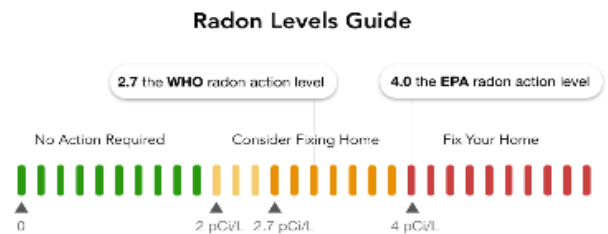

Device Information

Device S/N
RP22011190059

Device Calibrated
02/01/2023

Tester Information

Tester Name
Aaron Heugly

Tester Email
aaron@svinspections.com

Tester Address
123 Bellevue
Bellevue, Idaho 83313

Inspection Information

Delay Time
0 hour

Measured Radon Concentration Max
2.9 pCi/L

Inspection Duration
48 hours

Measured Radon Concentration Min
0.9 pCi/L

Measurement Started
11/10/2023 13:09

Measurement Ended
11/12/2023 13:12

Historical Radon Trend

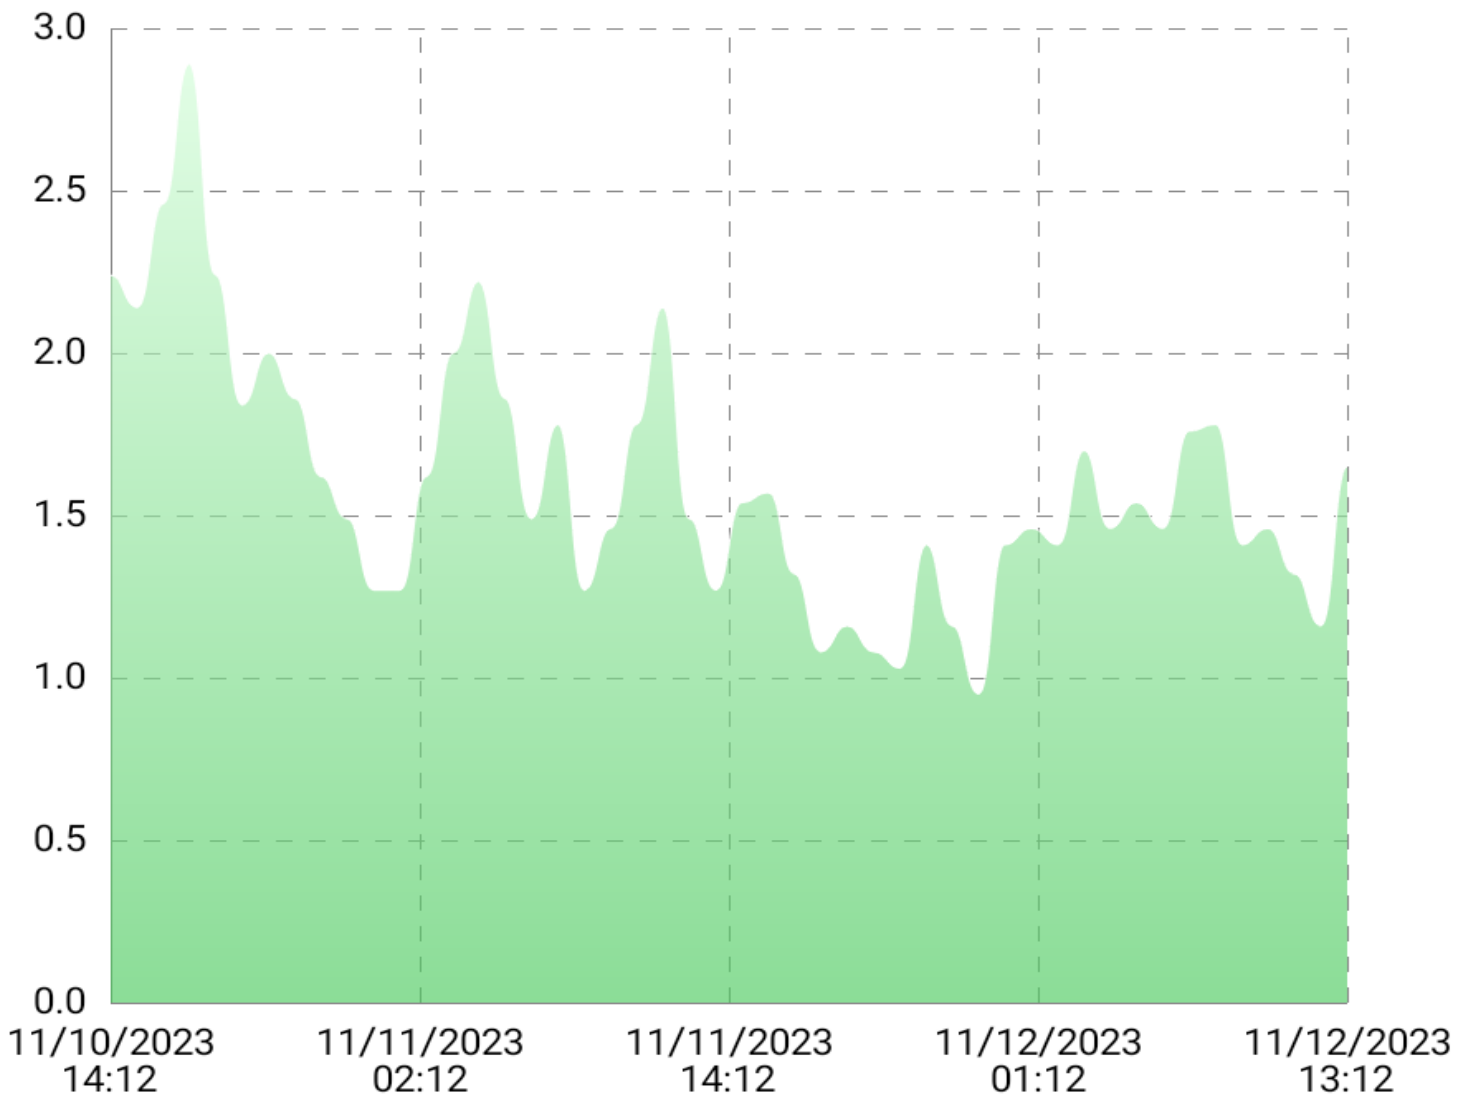


Table of Hourly Radon Measurements

Radon Concentration Average:
1.6 pCi/L

Timestamp	Radon Value	Temp (F)	RH(%)	Timestamp	Radon Value	Temp (F)	RH(%)
11/10/23 14:12	2.2	62	53	11/11/23 14:12	1.5	71	47
11/10/23 15:12	2.1	65	51	11/11/23 15:12	1.6	69	48
11/10/23 16:12	2.5	66	50	11/11/23 16:12	1.3	70	48
11/10/23 17:12	2.9	66	49	11/11/23 17:12	1.1	70	48
11/10/23 18:12	2.2	65	49	11/11/23 18:12	1.2	70	48
11/10/23 19:12	1.8	65	49	11/11/23 19:12	1.1	70	48
11/10/23 20:12	2.0	65	48	11/11/23 20:12	1.0	69	48
11/10/23 21:12	1.9	65	48	11/11/23 21:12	1.4	69	48
11/10/23 22:12	1.6	65	48	11/11/23 22:12	1.2	68	48
11/10/23 23:12	1.5	64	47	11/11/23 23:12	0.9	68	47
11/11/23 00:12	1.3	64	47	11/12/23 00:12	1.4	67	47
11/11/23 01:12	1.3	64	47	11/12/23 01:12	1.5	67	47
11/11/23 02:12	1.6	64	47	11/12/23 02:12	1.4	66	47
11/11/23 03:12	2.0	64	47	11/12/23 03:12	1.7	66	47
11/11/23 04:12	2.2	64	47	11/12/23 04:12	1.5	66	46
11/11/23 05:12	1.9	64	47	11/12/23 05:12	1.5	65	46
11/11/23 06:12	1.5	64	47	11/12/23 06:12	1.5	65	46
11/11/23 07:12	1.8	64	47	11/12/23 07:12	1.8	64	46
11/11/23 08:12	1.3	64	47	11/12/23 08:12	1.8	64	46
11/11/23 09:12	1.5	64	47	11/12/23 09:12	1.4	64	46
11/11/23 10:12	1.8	66	47	11/12/23 10:12	1.5	67	46
11/11/23 11:12	2.1	69	47	11/12/23 11:12	1.3	69	46
11/11/23 12:12	1.5	70	47	11/12/23 12:12	1.2	66	47

* Temperature and humidity can vary depending on environmental conditions.

* The test data was taken from a testing device approved by the National Radon Proficiency Program.