

Radon Inspection Report

Measurement Information

Client Name
Carissa Connelly

Measurement Started
08/05/2024 10:25

Measurement Ended
08/07/2024 10:25


Inspection Duration
48 hour (Data No: 48)

Building Year
2008

Building Type
House

Room Type
Bedroom

Floor
2nd floor

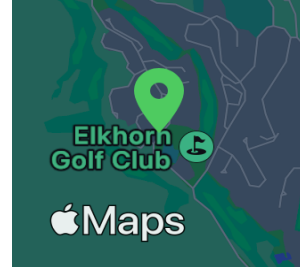


Measurement Location
106 Village Way
Hailey, Idaho 83353

Radon Levels Guide

Test Result: **< EPA Guidelines**

Overall Average
0.7 pCi/L

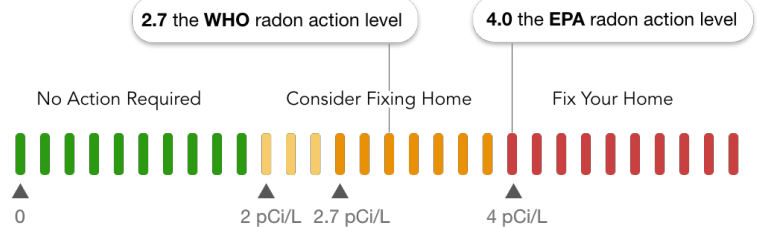

Device Information

Device S/N
RP22403200066

Device Calibrated
03/20/2024

Tester Information

Tester Name
Tanner Sanders

Certification # (State-License #)

Tester Email
tannersanders66@gmail.com

Tester Phone
208 659-2810

Tester Address
1908 Warm Springs rd
unit 13
Ketchum, Idaho 83340

Inspection Information

Delay Time

0 hours

Inspection Duration

48 hours

Measurement Started

08/05/2024 10:25

Measurement Ended

08/07/2024 10:25

Measured Radon Concentration Max

1.4 pCi/L

Measured Radon Concentration Min

0.0 pCi/L

Historical Radon Trend

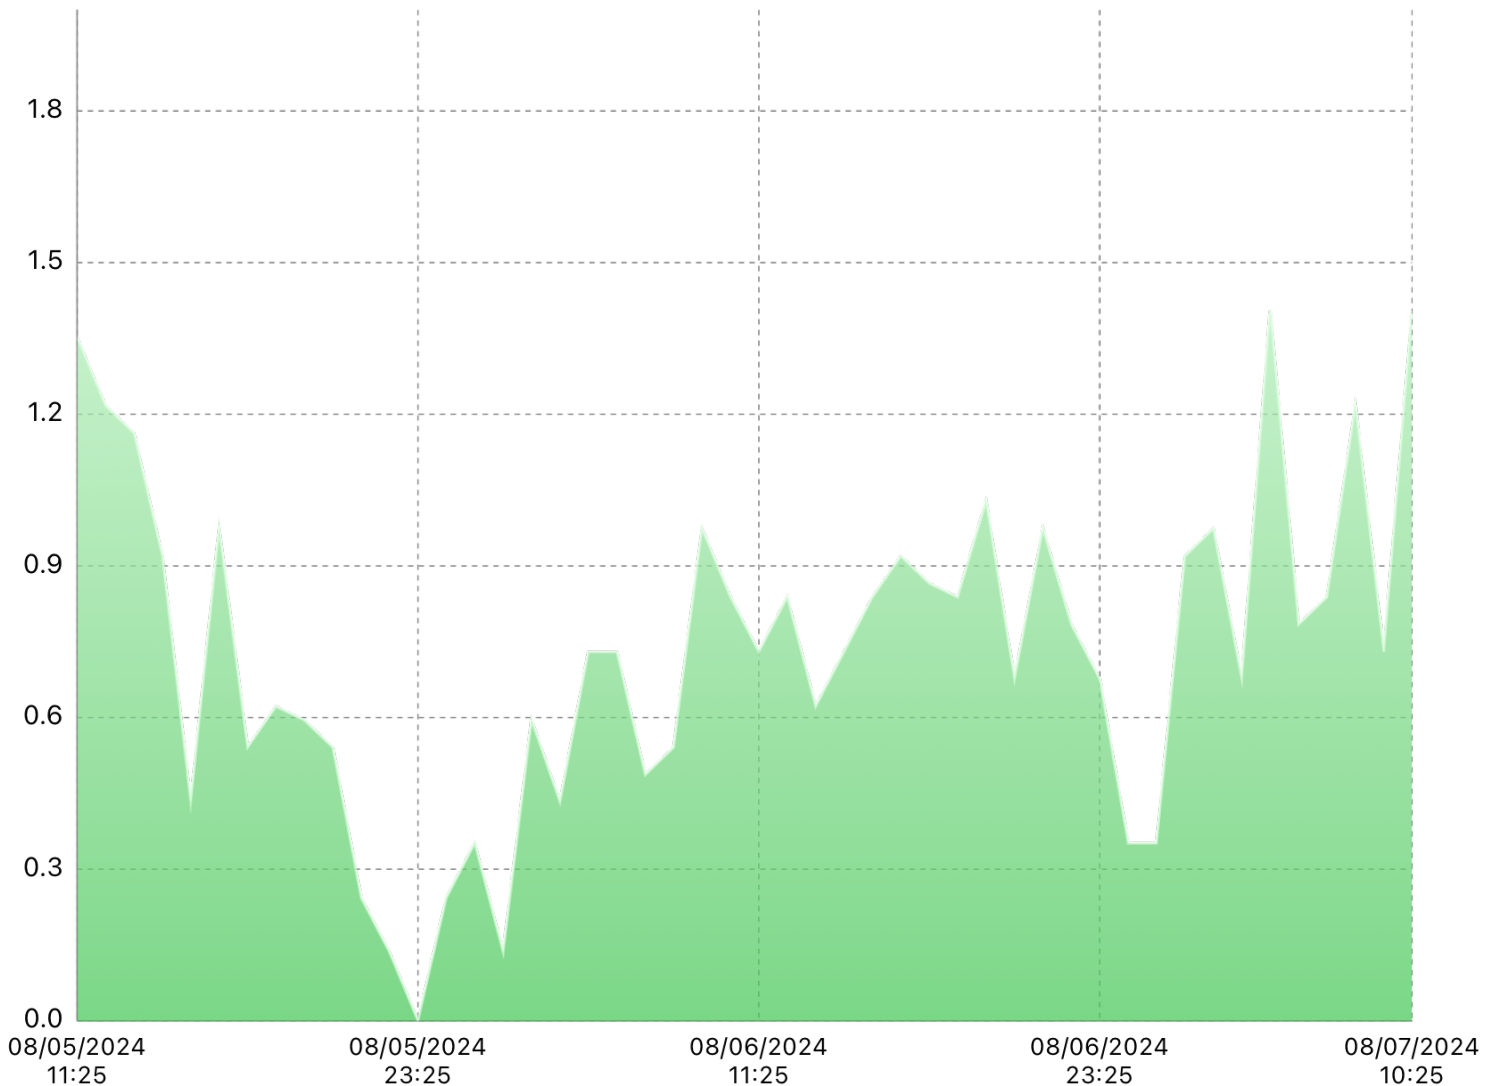


Table of Hourly Radon Measurements

Radon Concentration Average: 0.7 pCi/L

Timestamp	Radon Value	Temp(F)	RH(%)	Timestamp	Radon Value	Temp(F)	RH(%)
08/05/24 11:25	1.4	70	44	08/06/24 11:25	0.7	72	45
08/05/24 12:25	1.2	69	42	08/06/24 12:25	0.8	73	44
08/05/24 13:25	1.2	66	44	08/06/24 13:25	0.6	73	48
08/05/24 14:25	0.9	63	45	08/06/24 14:25	0.7	74	47
08/05/24 15:25	0.4	67	42	08/06/24 15:25	0.8	75	44
08/05/24 16:25	1.0	66	43	08/06/24 16:25	0.9	77	42
08/05/24 17:25	0.5	67	44	08/06/24 17:25	0.9	78	41
08/05/24 18:25	0.6	66	43	08/06/24 18:25	0.8	79	40
08/05/24 19:25	0.6	69	42	08/06/24 19:25	1.0	79	40
08/05/24 20:25	0.5	68	43	08/06/24 20:25	0.7	69	43
08/05/24 21:25	0.2	67	43	08/06/24 21:25	1.0	65	43
08/05/24 22:25	0.1	68	43	08/06/24 22:25	0.8	66	42
08/05/24 23:25	0.0	70	42	08/06/24 23:25	0.7	71	39
08/06/24 00:25	0.2	71	42	08/07/24 00:25	0.4	72	39
08/06/24 01:25	0.4	71	42	08/07/24 01:25	0.4	72	39
08/06/24 02:25	0.1	71	42	08/07/24 02:25	0.9	72	40
08/06/24 03:25	0.6	71	41	08/07/24 03:25	1.0	72	40
08/06/24 04:25	0.4	71	41	08/07/24 04:25	0.7	72	40
08/06/24 05:25	0.7	71	41	08/07/24 05:25	1.4	72	40
08/06/24 06:25	0.7	71	41	08/07/24 06:25	0.8	72	40
08/06/24 07:25	0.5	72	42	08/07/24 07:25	0.8	72	41
08/06/24 08:25	0.5	72	42	08/07/24 08:25	1.2	72	43
08/06/24 09:25	1.0	72	42	08/07/24 09:25	0.7	72	42
08/06/24 10:25	0.8	72	42	08/07/24 10:25	1.4	72	41

* Temperature and humidity can vary depending on environmental conditions.

* The test data was taken from a testing device approved by the National Radon Proficiency Program.

Table of Hourly Radon Measurements

Radon Concentration Average: 0.7 pCi/L

Timestamp	Radon Value	Temp(F)	RH(%)	Timestamp	Radon Value	Temp(F)	RH(%)
Event							
Movement	08/07/2024 08:45						

* Temperature and humidity can vary depending on environmental conditions.

* The test data was taken from a testing device approved by the National Radon Proficiency Program.