

Radon Inspection Report

Measurement Information

Client Name
Carissa Connelly

Measurement Started
08/20/2024 14:09

Measurement Ended
08/22/2024 14:09

Inspection Duration
48 hour (Data No: 48)

Building Year
2006

Building Type
House

Room Type
Bedroom

Floor
2nd floor




Measurement Location
106 Village Way
Hailey, Idaho 83353

Radon Levels Guide

Test Result: **< EPA Guidelines**

Overall Average
1.3 pCi/L

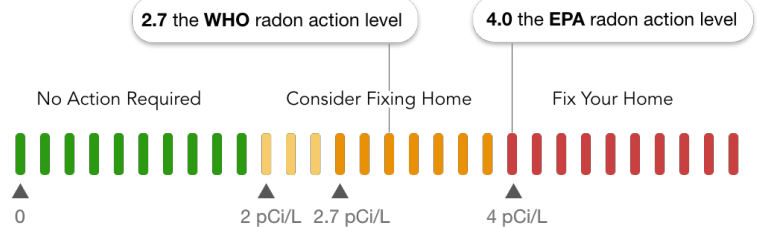

Device Information

Device S/N
RP22103040067

Device Calibrated
03/08/2021

Tester Information

Tester Name
Tanner Sanders

Certification # (State-License #)

Tester Email
tannersanders66@gmail.com

Tester Phone
208 659-2810

Tester Address
1908 Warm Springs rd
unit 13
Ketchum, Idaho 83340

Inspection Information

Delay Time

0 hours

Inspection Duration

48 hours

Measurement Started

08/20/2024 14:09

Measurement Ended

08/22/2024 14:09

Measured Radon Concentration Max

2.0 pCi/L

Measured Radon Concentration Min

0.6 pCi/L

Historical Radon Trend

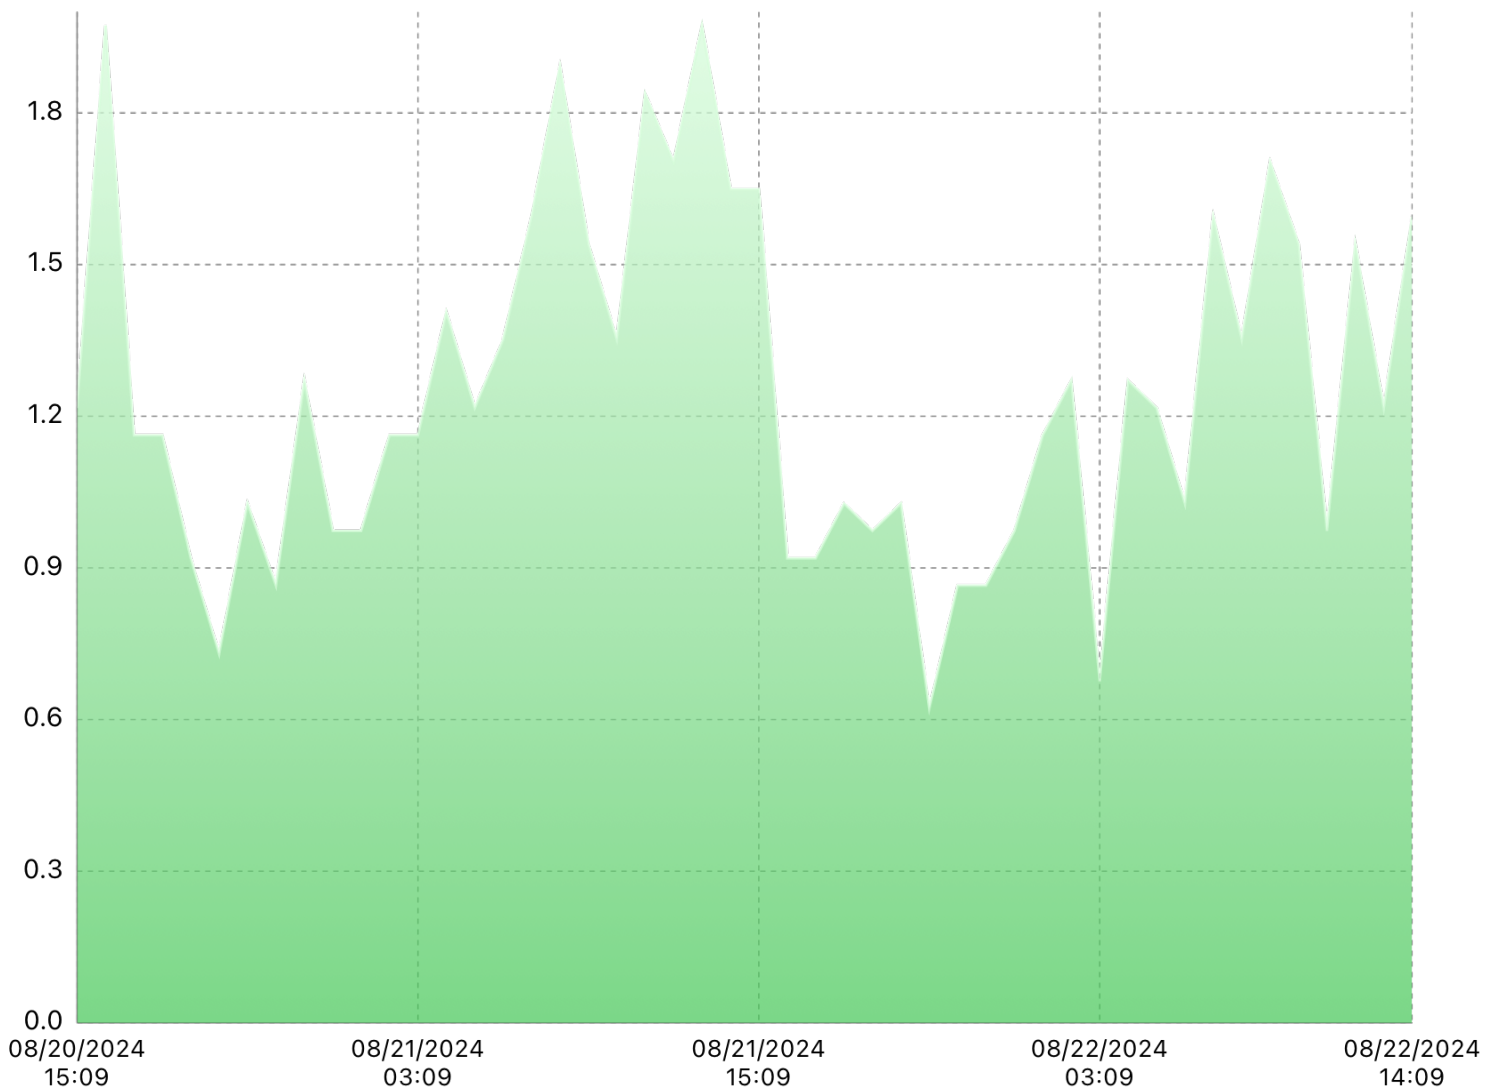


Table of Hourly Radon Measurements

Radon Concentration Average: 1.3 pCi/L

Timestamp	Radon Value	Temp(F)	RH(%)	Timestamp	Radon Value	Temp(F)	RH(%)
08/20/24 15:09	1.2	72	45	08/21/24 15:09	1.6	72	41
08/20/24 16:09	2.0	72	44	08/21/24 16:09	0.9	72	40
08/20/24 17:09	1.2	72	44	08/21/24 17:09	0.9	73	40
08/20/24 18:09	1.2	73	44	08/21/24 18:09	1.0	74	40
08/20/24 19:09	0.9	73	44	08/21/24 19:09	1.0	74	40
08/20/24 20:09	0.7	73	43	08/21/24 20:09	1.0	74	40
08/20/24 21:09	1.0	73	43	08/21/24 21:09	0.6	74	40
08/20/24 22:09	0.9	73	43	08/21/24 22:09	0.9	74	40
08/20/24 23:09	1.3	72	43	08/21/24 23:09	0.9	73	40
08/21/24 00:09	1.0	72	43	08/22/24 00:09	1.0	73	40
08/21/24 01:09	1.0	72	43	08/22/24 01:09	1.2	72	40
08/21/24 02:09	1.2	72	43	08/22/24 02:09	1.3	72	40
08/21/24 03:09	1.2	72	43	08/22/24 03:09	0.7	72	40
08/21/24 04:09	1.4	71	43	08/22/24 04:09	1.3	72	40
08/21/24 05:09	1.2	72	42	08/22/24 05:09	1.2	71	40
08/21/24 06:09	1.4	72	42	08/22/24 06:09	1.0	71	40
08/21/24 07:09	1.6	72	41	08/22/24 07:09	1.6	71	40
08/21/24 08:09	1.9	71	42	08/22/24 08:09	1.4	72	40
08/21/24 09:09	1.5	71	41	08/22/24 09:09	1.7	71	40
08/21/24 10:09	1.4	71	42	08/22/24 10:09	1.5	71	40
08/21/24 11:09	1.8	71	42	08/22/24 11:09	1.0	71	40
08/21/24 12:09	1.7	71	42	08/22/24 12:09	1.5	71	40
08/21/24 13:09	2.0	72	42	08/22/24 13:09	1.2	72	40
08/21/24 14:09	1.6	72	41	08/22/24 14:09	1.6	72	39

* Temperature and humidity can vary depending on environmental conditions.

* The test data was taken from a testing device approved by the National Radon Proficiency Program.